

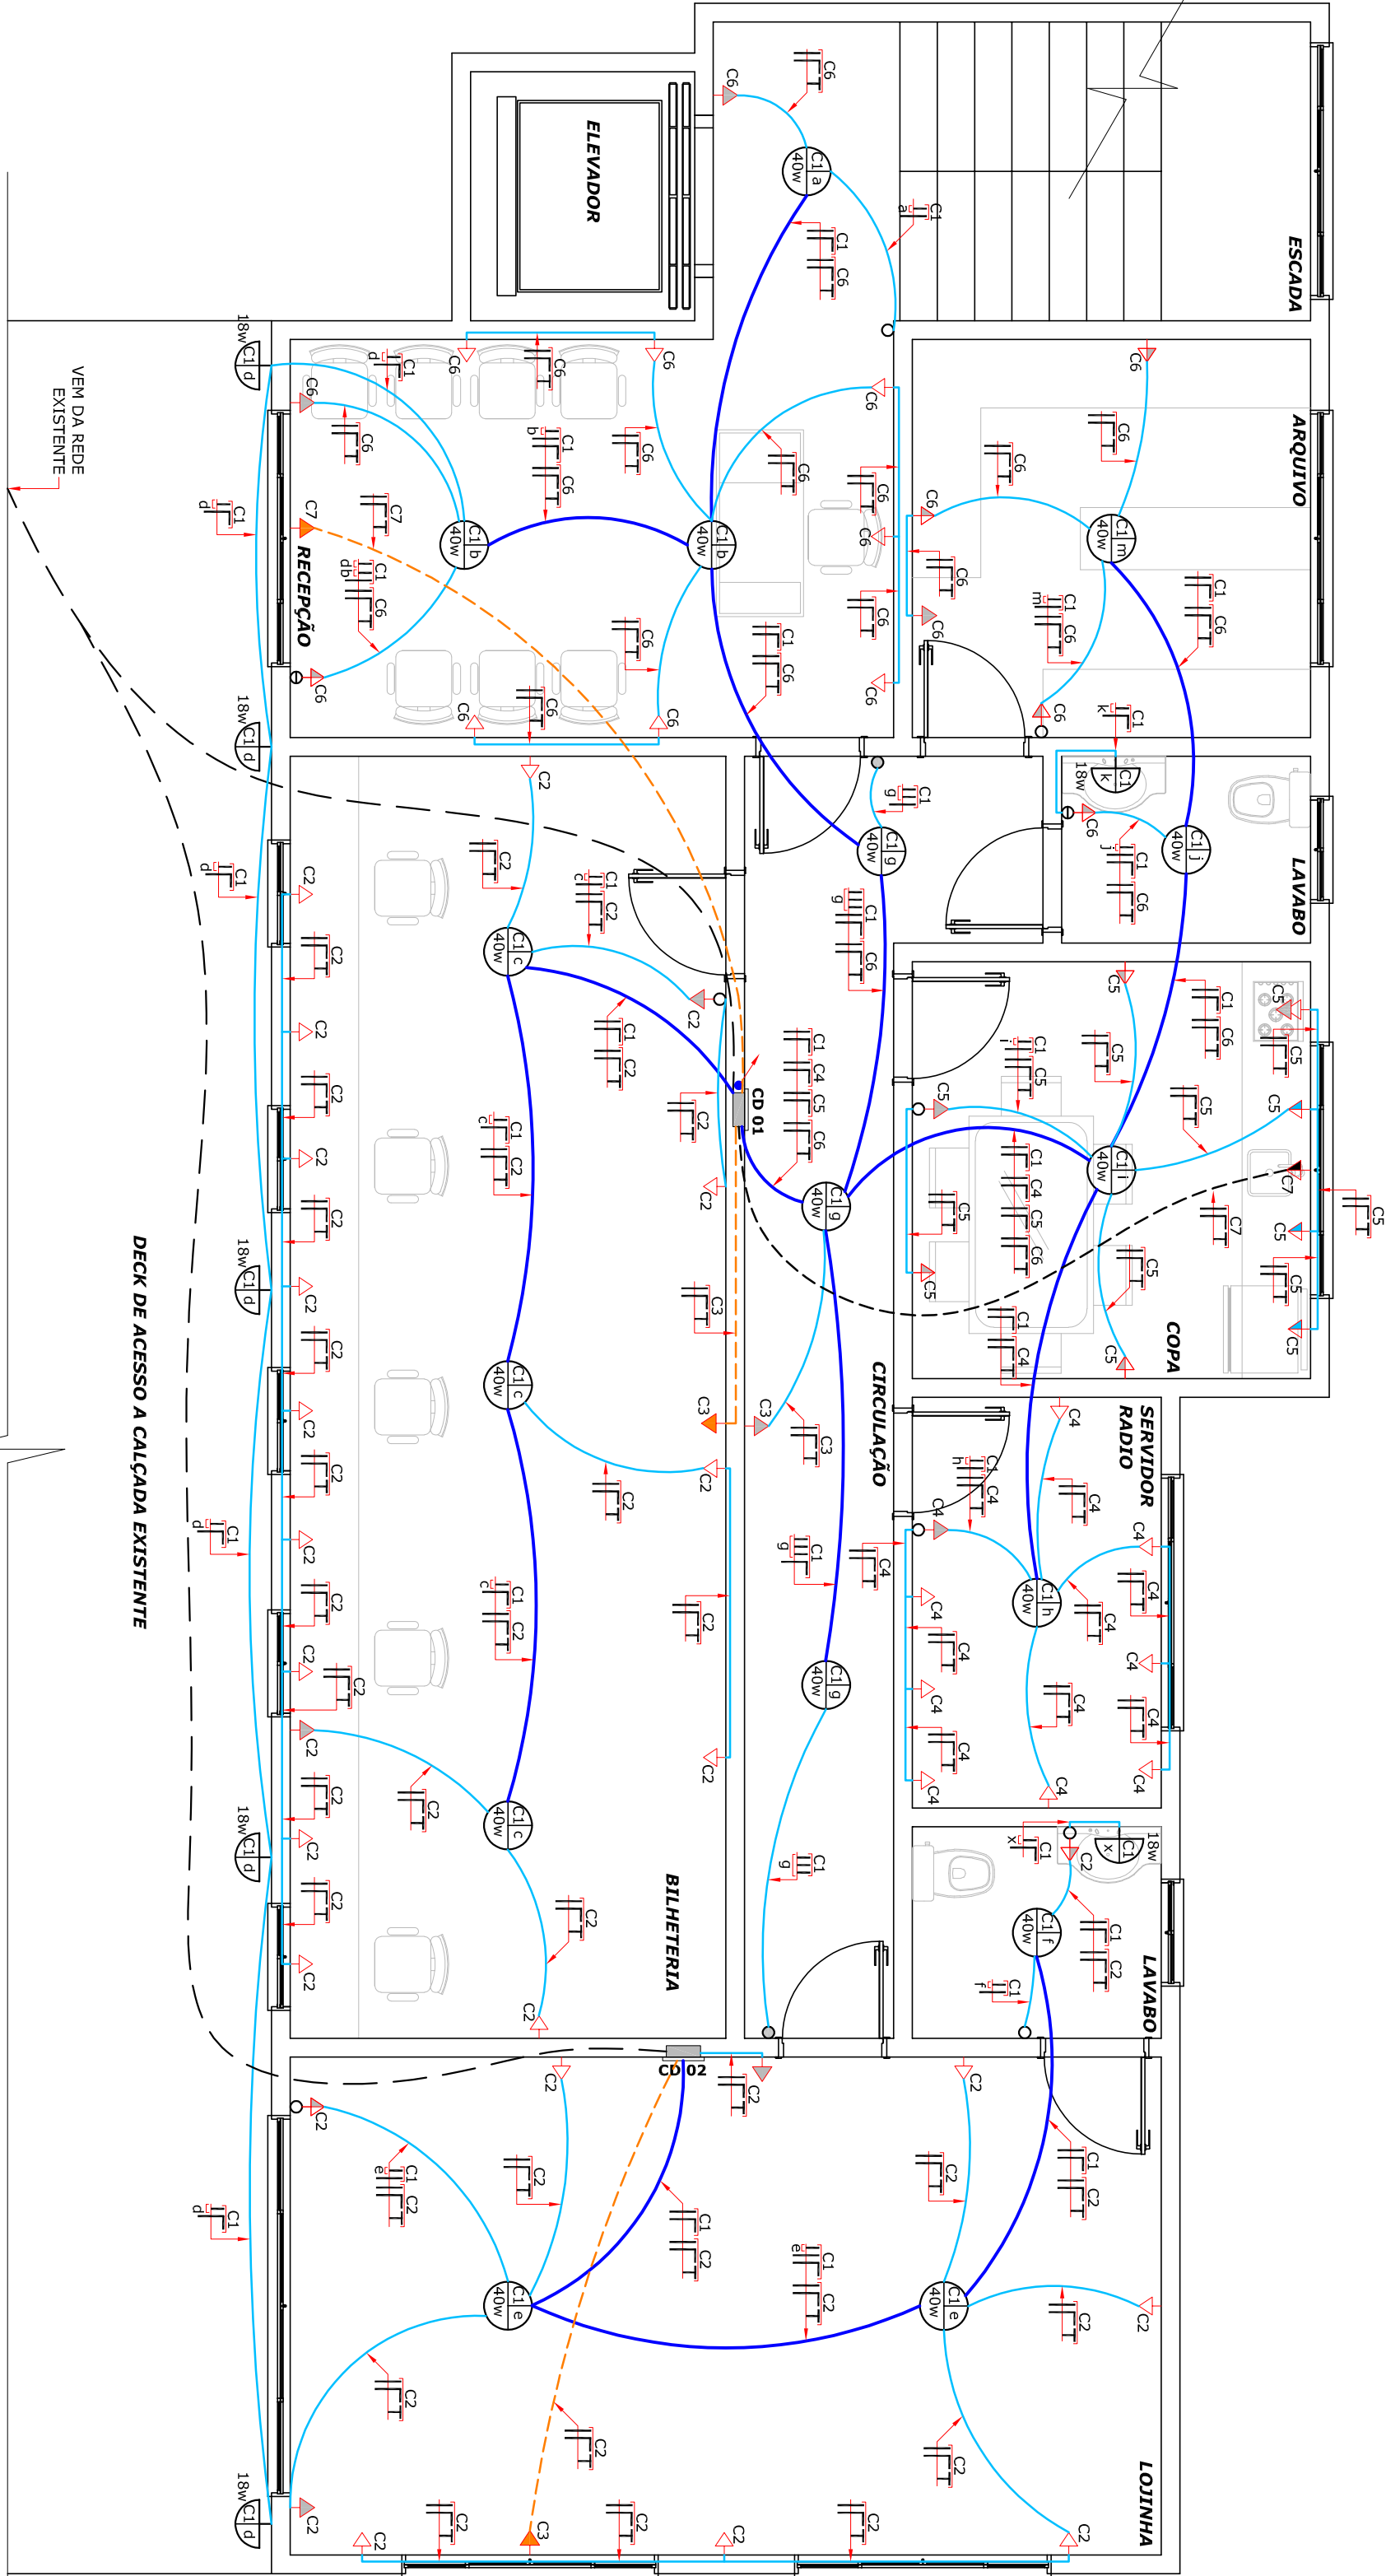
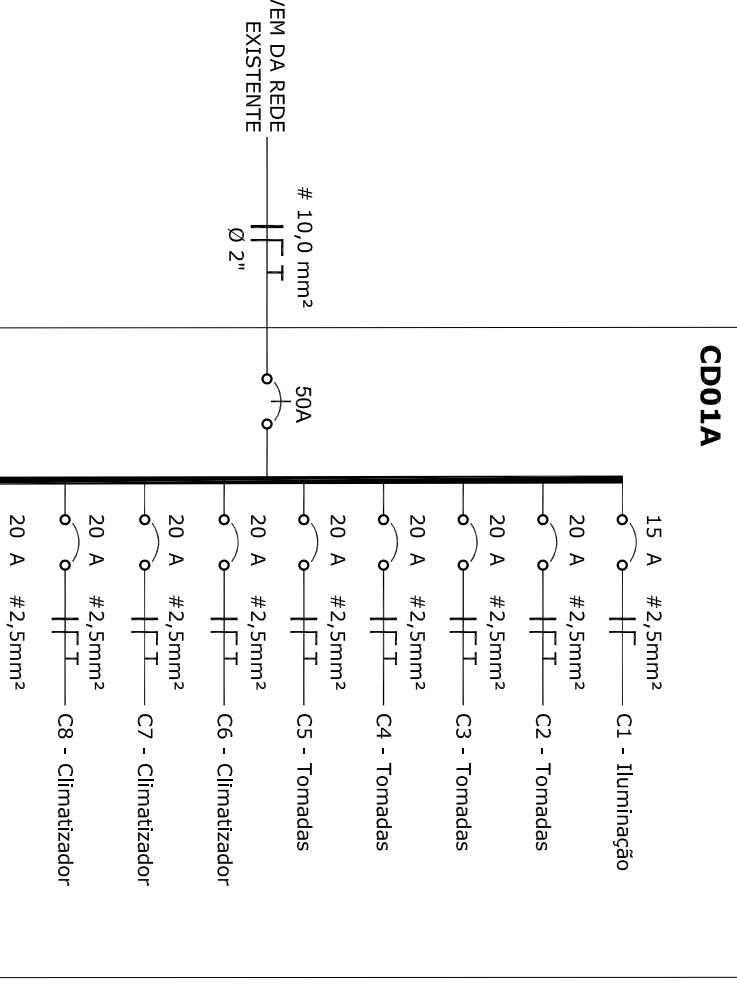
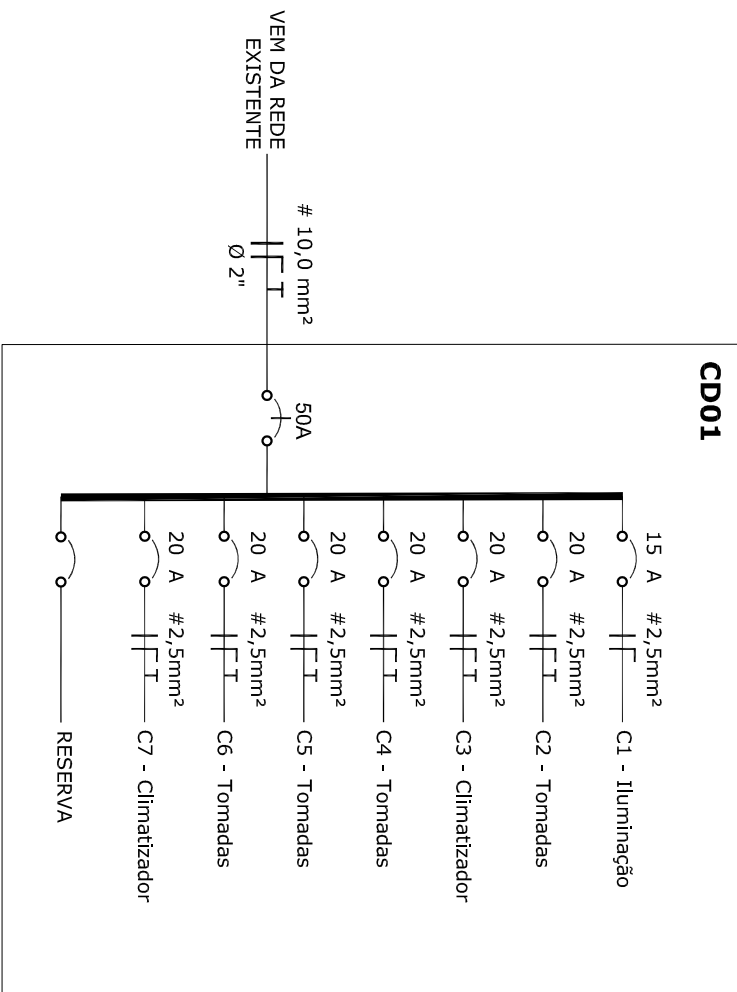


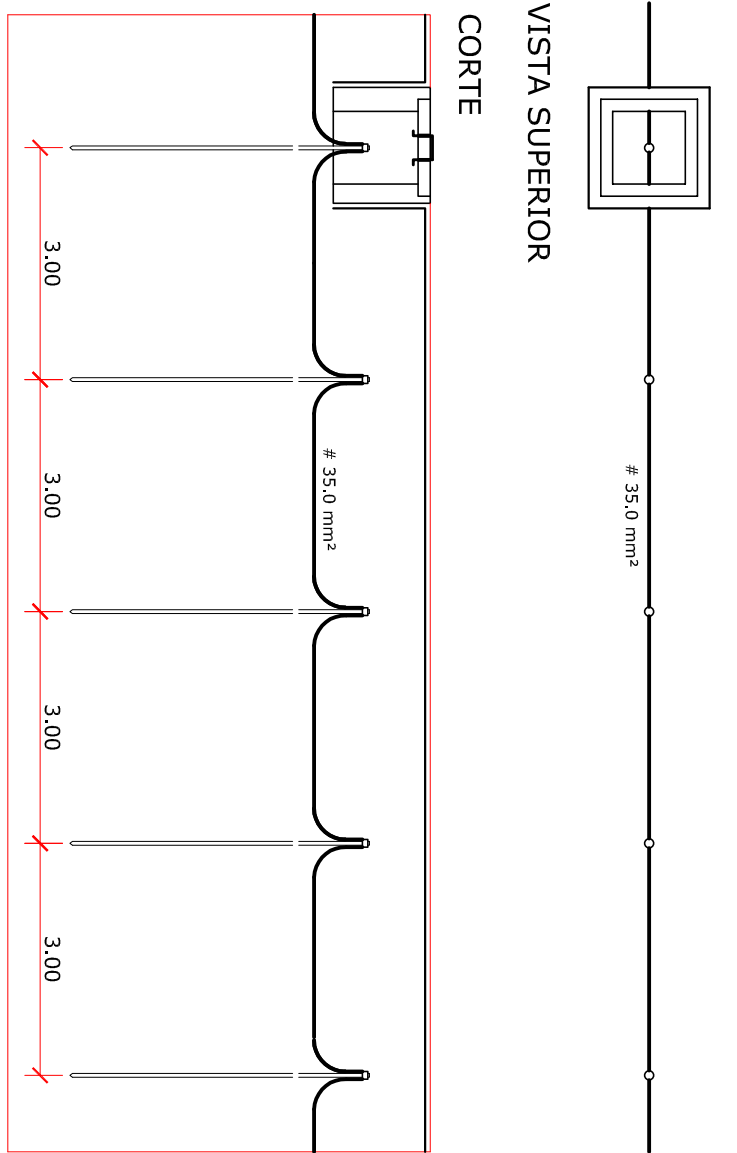

PLANTA BAIXA PTO TÉRREO
PROJETO ELÉTRICO
ESCALA = 1 : 50

PLANTA BAIXA
PTO SUPERIOR
PROJETO ELÉTRICO
ESCALA = 1 : 50

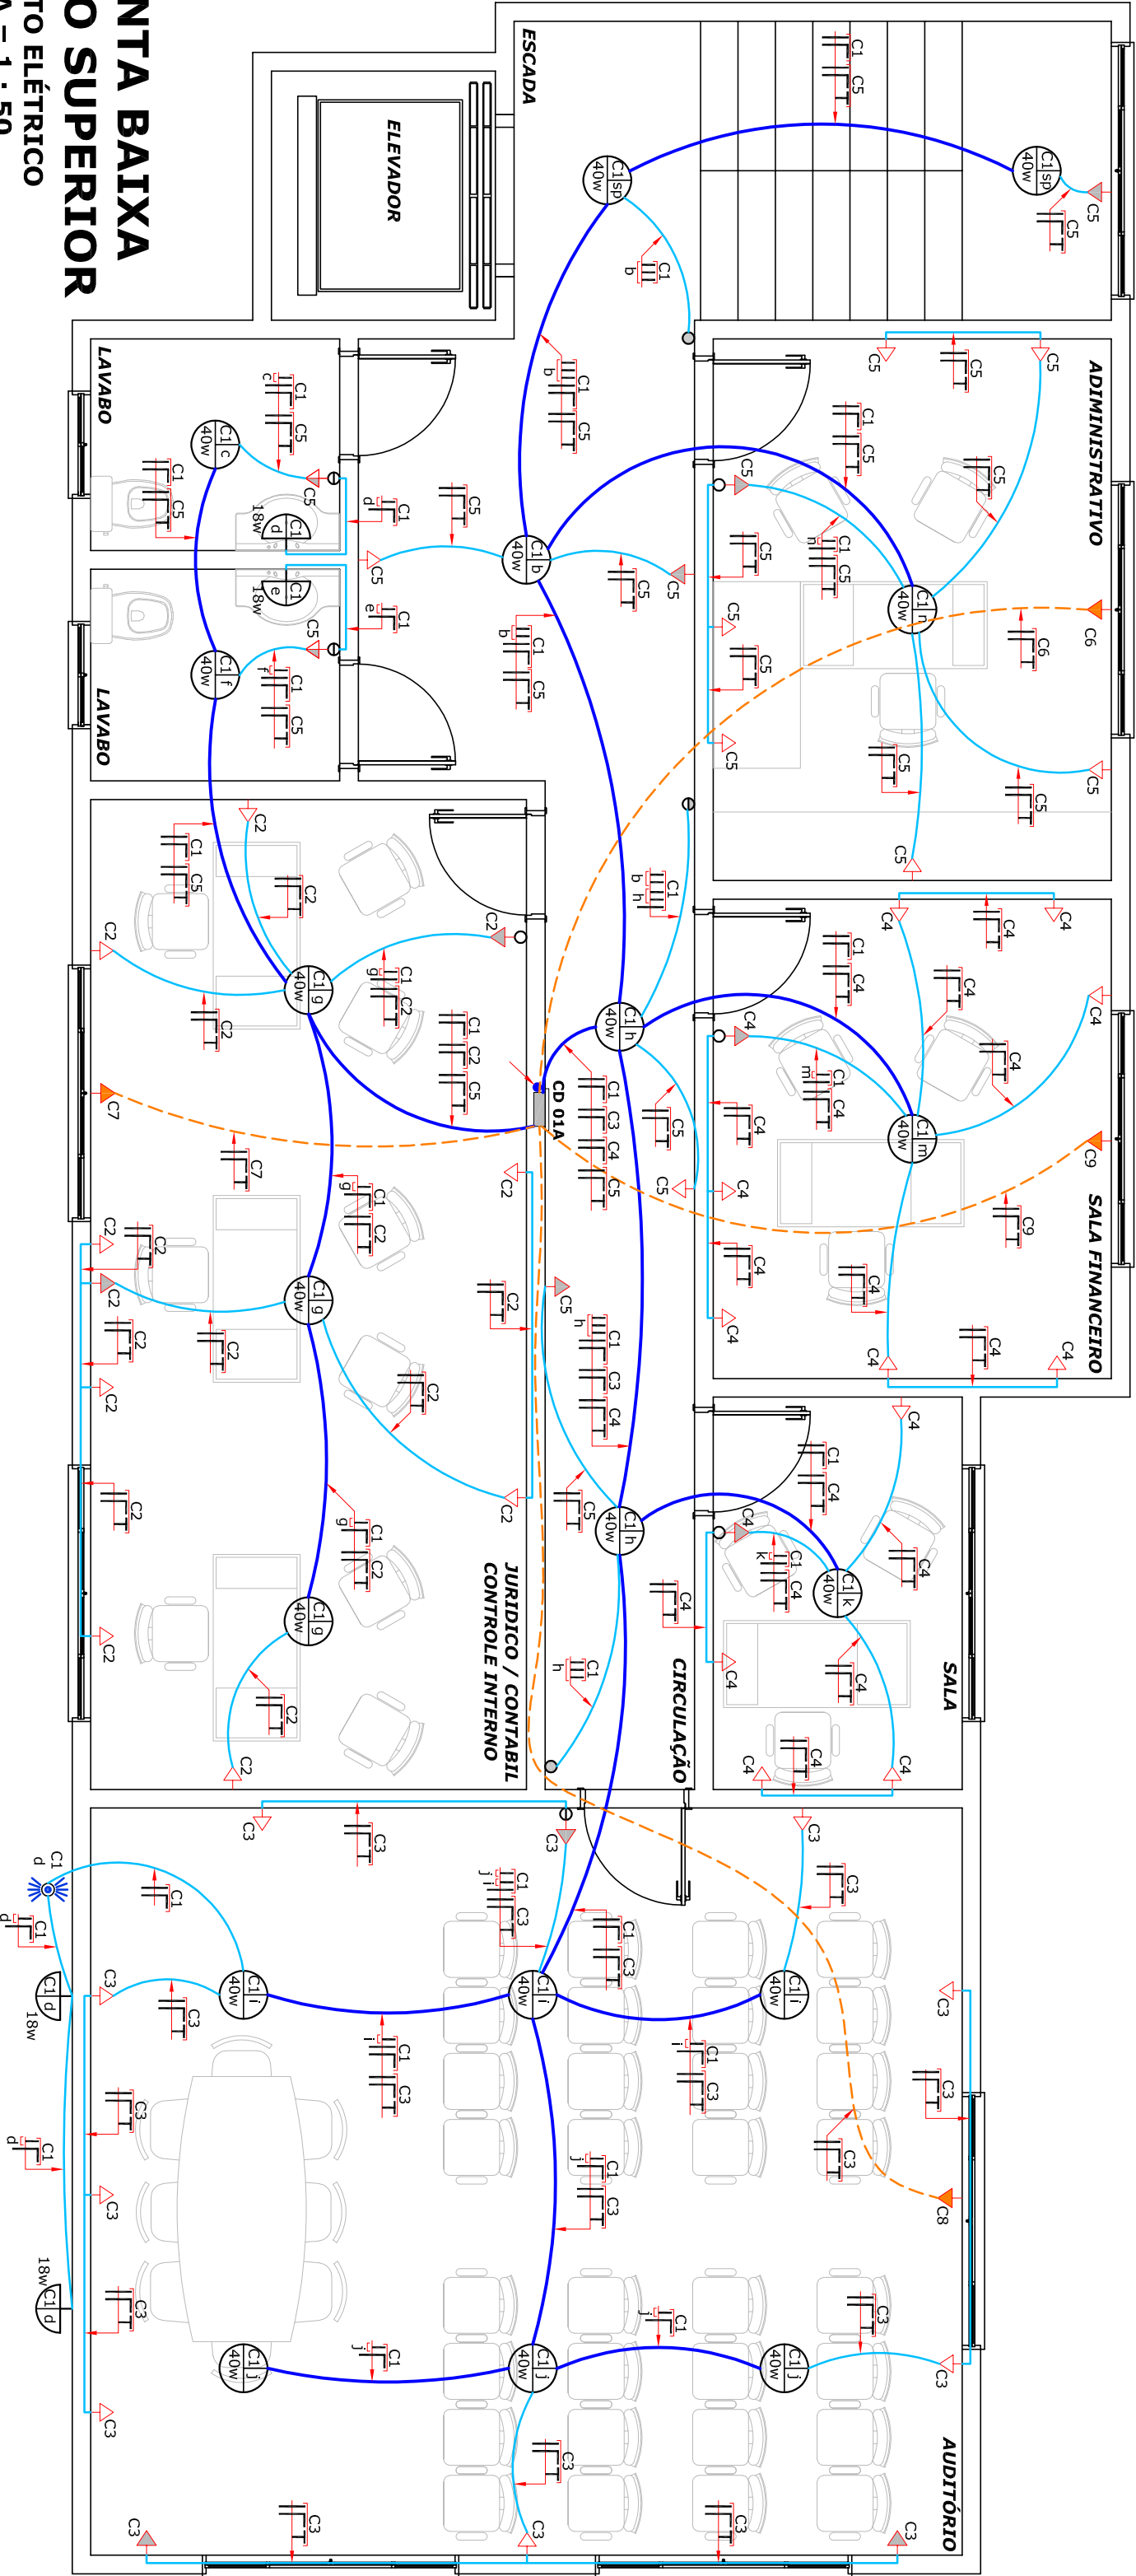

QUADRO DE CARGA									
CD 01									
CIRCUITO	LUMINÂNCIA	TOMADAS	CARGA	BITOLA	PROTEÇÃO	FASE			
C1	5	13	1600	2,5	15 A	R			
C2	13	16	1,600	2,5	20 A	R			
C3	9	1	900	2,5	20 A	R			
C4	13	6	3	2,5	20 A	R			
C5	6	3	2,400	2,5	20 A	R			
C6	15	15	1,500	2,5	20 A	R			
C7	15	1	900	2,5	20 A	R			
RES.									
TOTAL	5	0	13	46	3	0	2	0	0
				</					